

ET 915.07 *Air Conditioning Model*



- * **Complete model of a full air conditioning system**
- * **Heating, cooling, humidifying and dehumidifying**
- * **Outer air and recirculation operation possible**
- * **Component control and fault simulation via the educational software**

Technical Description

ET 915.07 is part of the HSI training system for refrigeration and air conditioning technology. In combination with the base unit ET 915 the operational model of a full air conditioning system is created. The model is plugged onto the base unit, secured using fasteners and connected with refrigerant hoses to become a complete refrigeration circuit for the air cooler.

The room climate is created by the interaction of air temperature, heating temperature and air humidity. The purpose of room air conditioning is to shape the room climate in accordance with the requirements of people or sensitive goods. This model introduces the operation of an air conditioning system and the recirculating air and outer air operating modes.

The model ET 915.07 includes two air ducts with transparent front. The top air duct serves as climatic chamber whilst the bottom air duct contains the air cooler, two electric air heaters and a steam humidifier. A fan between the two air ducts recirculates the air. A motorised butterfly valve in the top air duct allows a change between outer air and recirculating operation. Dependent on the switching of the two air heaters, the air cooler and the humidifier, the air in the duct system can be cooled, heated, humidified or dehumidified.

The individual system components are controlled via the educational software which is included in the scope of delivery of the base unit ET 915. Temperature and humidity before and after the evaporator and

in the climatic chamber are recorded by sensors, digitised and represented dynamically in the educational software. The conditioning of the air can be monitored online in the h-x diagram.


Learning Objectives / Experiments

- Full air conditioning system and its main components
- Heating and cooling in the h-x diagram
- Humidifying and dehumidifying in the h-x diagram
- Outer air and recirculating operation
- Fault simulation


ET 915.07 Air Conditioning Model



1 air duct, 2 air reheater, 3 process schematic, 4 air humidifier, 5 connections for ET 915, 6 evaporator, 7 expansion valve, 8 air preheater, 9 fan, 10 sensors for humidity and temperature, 11 ventilation flap

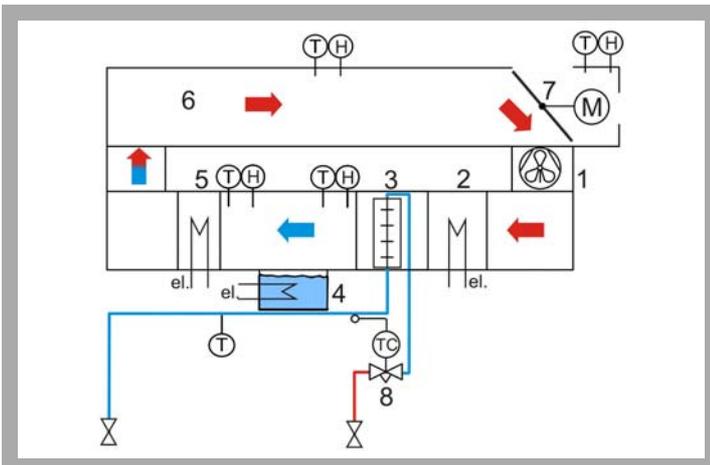

Air conditioning with recirculating operation: 1 fan, 2 air preheater, 3 air cooler, 4 air humidifier, 5 air reheater, 6 air duct, 7 ventilation flap with servomotor, 8 expansion valve; T temperature, P pressure, H humidity; red arrow: hot, blue arrow: cold; blue: low pressure, red: high pressure

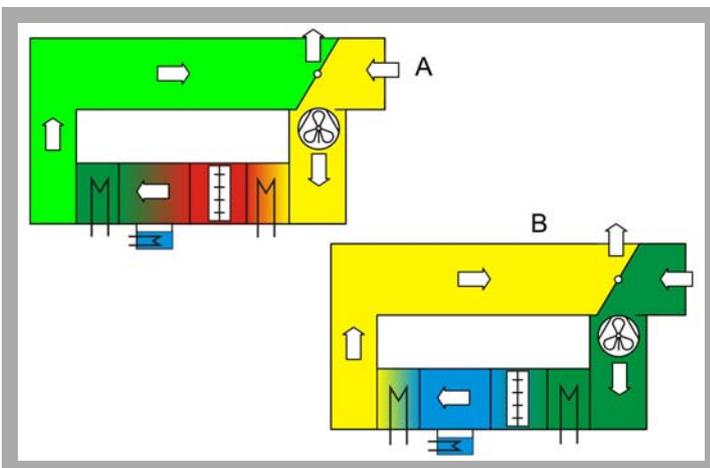

Air conditioning with outer air operation; A: humidification, B: dehumidification; yellow: dry, green: humid, blue: cooling, red: heating

Specification

- [1] Model of an air conditioning system to plug onto the base unit ET 915
- [2] GUNT training system with HSI technology
- [3] Air duct with transparent front and adjustable ventilation flap for recirculating or outer air operation
- [4] Evaporator as air cooler
- [5] 2 heaters as air preheater and reheater
- [6] Air humidifier with float switch, fan, filling level indication
- [7] Thermostatic expansion valve as expansion element
- [8] Sensor to record temperature and combined sensor for humidity and temperature
- [9] Units and fault simulation controlled via educational software

Technical Data

- Air duct, top: 136x136x800mm
- Evaporator as air cooler
 - transfer area: approx. 900cm²
- Air heater: 2x 250W
- Axial fan
 - max. power consumption: 19W
 - max. flow rate: 160m³/h
- Humidifier
 - heater: 200W
- Servomotor for ventilation flap: 24VDC

Measuring ranges

- temperature: 2x -50...50°C, 4x 0...50°C
- humidity: 4x 10...100% r.h.

Dimensions and Weight

- LxWxH: 850x400x680mm
- Weight: approx. 51kg

Scope of Delivery

- 1 air conditioning system model, filled with refrigerant

Order Details

061.91507 ET 915.07 Air Conditioning Model

ET 915.07 *Air Conditioning Model*

Available accessories

Item no.	Order Details
061.915	ET 915 HSI Training System Refrigeration and Air Conditioning Technology, Base Unit